


## Honeywell Power Supply Ionizer Jumper P5

The Honeywell power supply upgrade in 2012 have a jumper labeled P5 for setting the ionizer current. The setting is based on the combined size of the collector cells or size of your EAC.

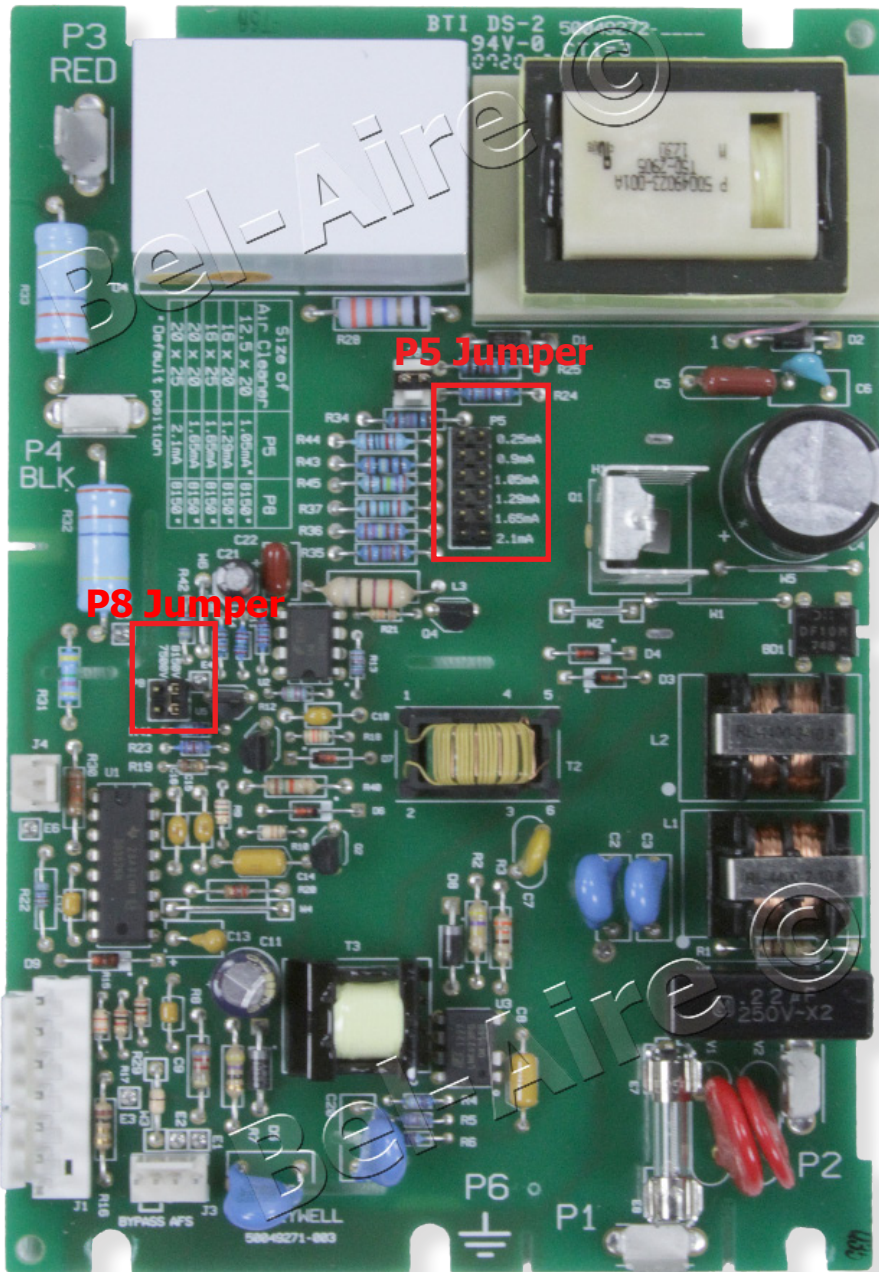

Size of Air Cleaner	P5 Jumper Position	P8 Jumper
12.5 x 20	1.05 mA	8150
16 x 20	1.29 mA	8150
16 x 25	1.65 mA	8150
20 x 20	1.65 mA	8150
20 x 25	2.1 mA	8150

The P8 jumper drops the voltage from 8150v to 7500v for less ozone output. The descendent power supply have ionizer jumper labelled J6 and only had three setting. The new power supply are more flexible and more universal along with better power surge protection.